


INSTRUCTION

SDT-System

REGIOLUX

REGIOLUX GmbH
D-97484 Königshausen/Bay.
Telefon (0 95 25) 89-0
Telefax (0 95 25) 89 73 4
http://www.regiolux.de
e-Mail: info@regiolux.de

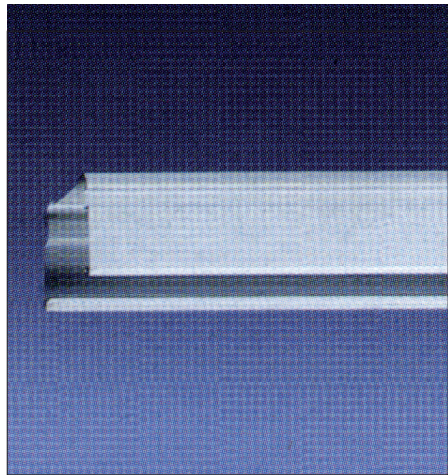



SDT	182	.
SDCS	1890 0034	100
SDCSE	1890 0044	100
SDH	1890 0039	100
SDD	1890 0033	100
SDCT	1890 0042	100
SDTAF-7	1820 3092	100
SDTAF-11	1820 2092	100

IP54		
SDGS	1846	100
SDGFF	1844	100
SDGS-LED	1846	100
SDBAS	1882 6580	100
SDTES	1890 0235	100
SDTVLS	1820 0050	100

IP20		
SDG	1820	100
SDGV	1820	150
SDGVL-LED	1821	150
SDGL.-LED	1823 / 183.	100
SDG.-LED	1823 / 183.	100
SDBK	1883 7580	100
SDTE	1890 0231	100
SDTV	1820 0020	100
SDTVL	1820 0031	100

IP40		
SDGV-LED	1820	150

IP20/54/40

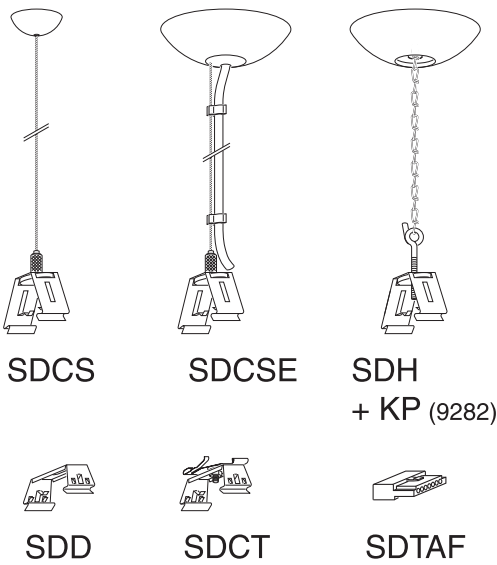

SDTES




SDTE

IP54

SDTES



SDTVLS




IP40


SDTES




SDTV




SDTVL




SDT




IP20

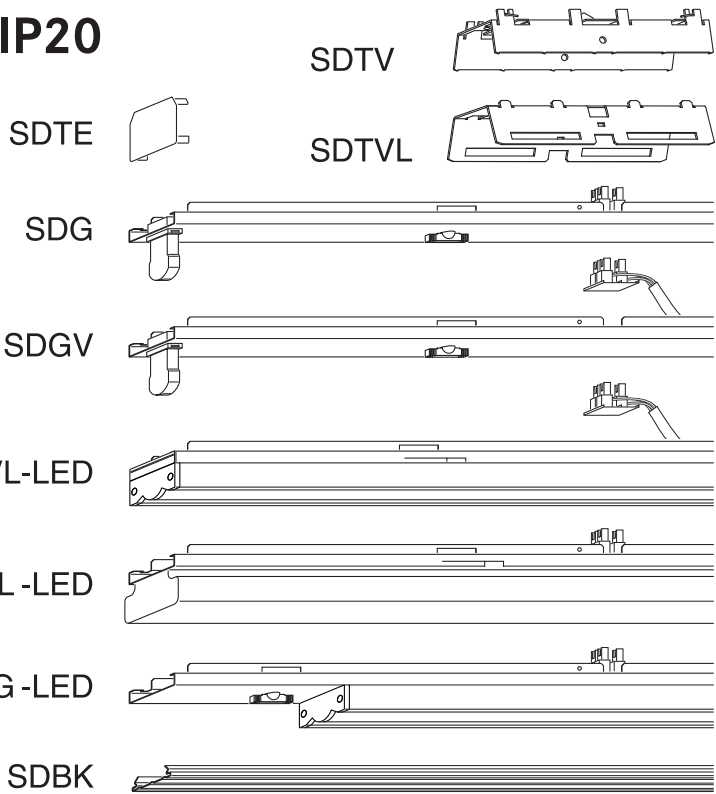


SDGS/SDGFF




SDGS-LED



SDBAS


















SDGV-LED




SDBK



SDBAS

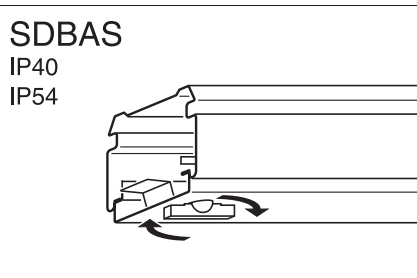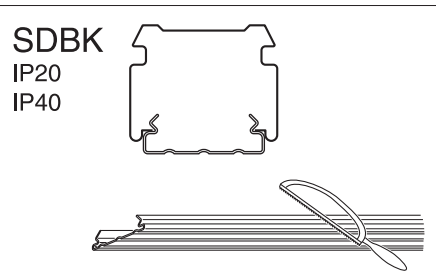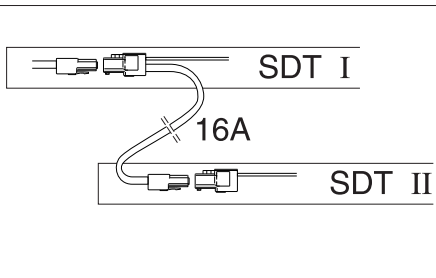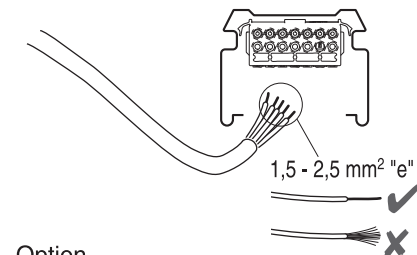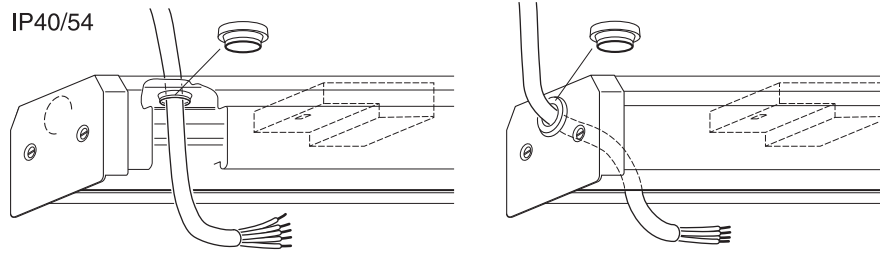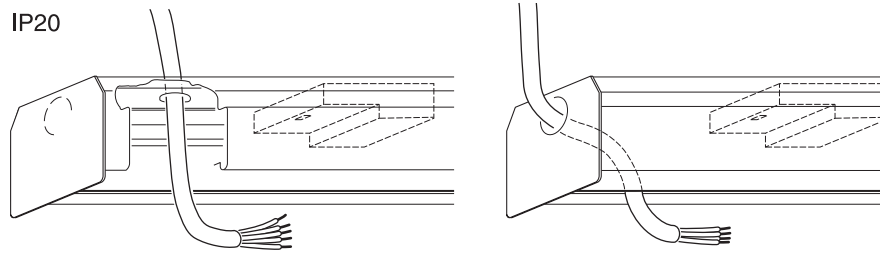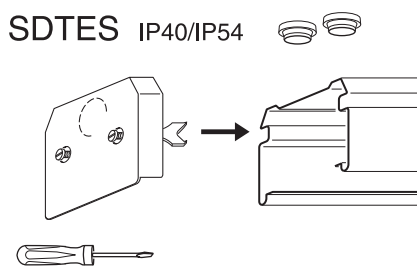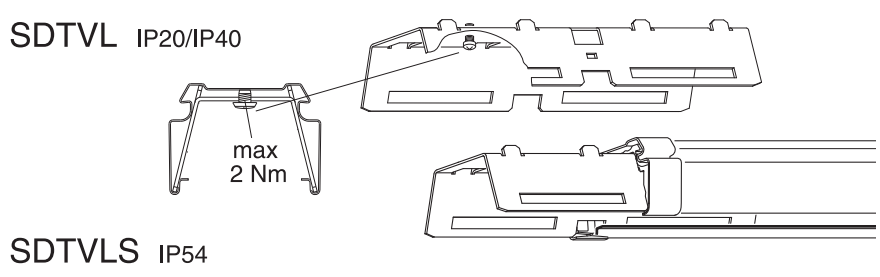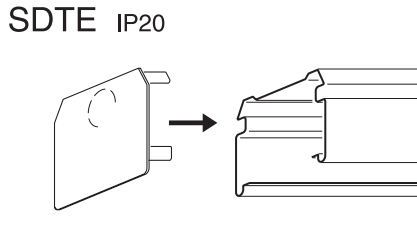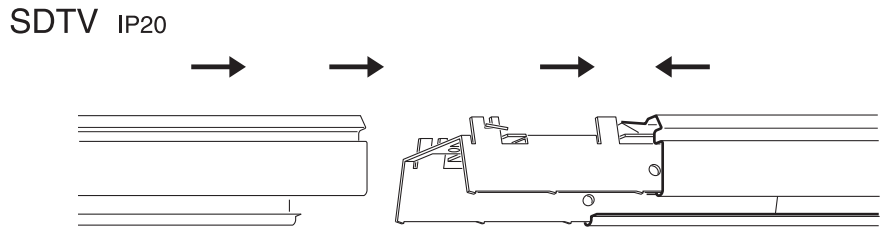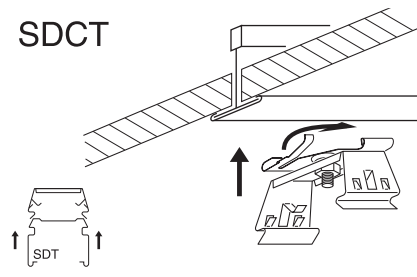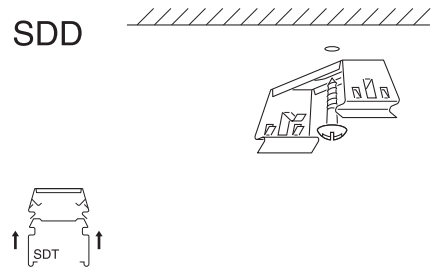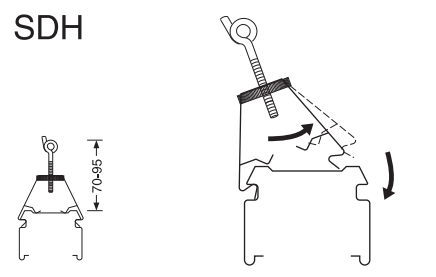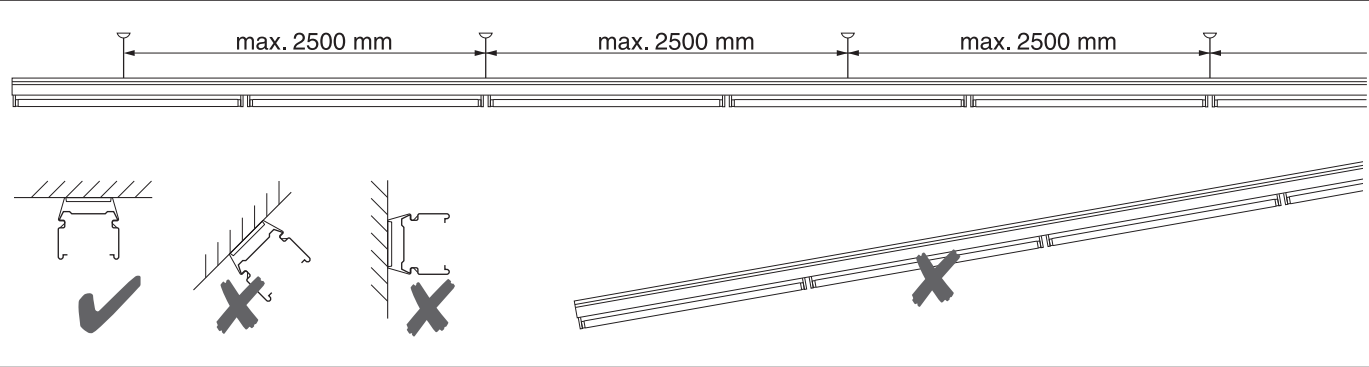


Zulässige Stromstärken bei Tragschiene SDT

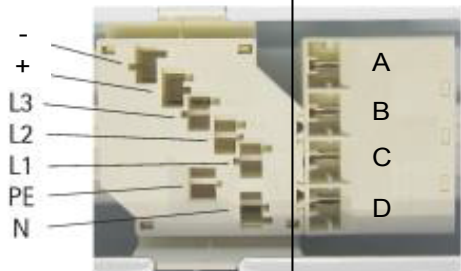Verdrahtung Tragschiene	max. Stromstärken		
	5/7 Leiter	4 Zusatzleiter	
5 x 1,5mm ²	4 x 16A	-x-	
7 x 1,5mm ²	5 x 16A	-x-	
alternativ	4 x 16A + 2 x 10A	-x-	
5 x 2,5mm ²	4 x 16A	-x-	
7 x 2,5mm ²	5 x 16A	-x-	
*! 7 x 2,5mm ² + 4 x 1,5mm ²	4 x 16A + 2 x 10A	4 x 10A	
	6 x 16A	4 x 5A	

Für die Tragschiene ist gemäß VDE 0100 der Betriebsstrom, der verwendete Leitungsquerschnitt, die Schleifenimpedanz sowie die Charakteristik und der Nennstrom des Absicherungsorgans zu beachten.

Permissible rated current für mounting rail SDT

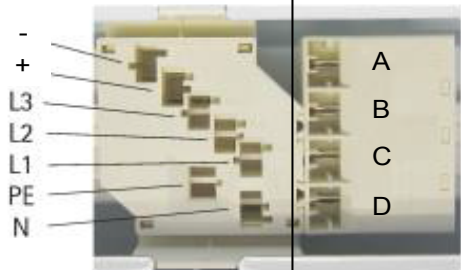Wiring rail	max. rated current		
	5/7 conductors	4 conductors	
5 x 1,5mm ²	4 x 16A	-x-	
7 x 1,5mm ²	5 x 16A	-x-	
alternativ	4 x 16A + 2 x 10A	-x-	
5 x 2,5mm ²	4 x 16A	-x-	
7 x 2,5mm ²	5 x 16A	-x-	
*! 7 x 2,5mm ² + 4 x 1,5mm ²	4 x 16A + 2 x 10A	4 x 10A	
	6 x 16A	4 x 5A	

As per VDE 0100 for the rails the operation voltage, the cross section of the conductors, the loop impedance as well as the characteristics and the rated current of the safety fuse have to be considered.

Steckerbelegung der Geräteträger bei Schaltung >3-pol.

Assignment of plugs of the device mounts if Circuit >3-conductors.

